


[TANK INSTALLATION GUIDELINES]

Underground container.

Must have legible Data Plate

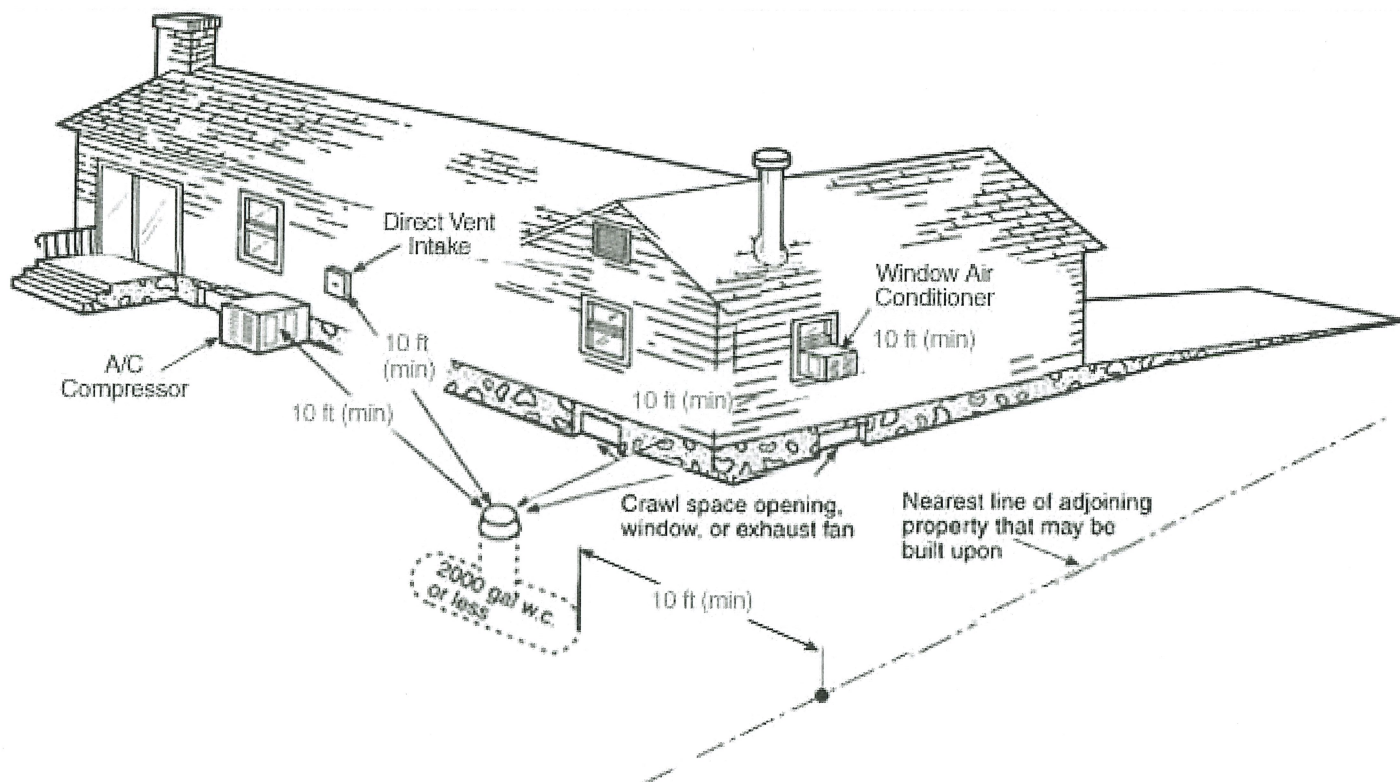

Note: When the cylinder is filled on site from a bulk truck, the filling connection valve and vent valve must be at least 10 feet from any exterior source of ignition, opening into direct-vent appliances, or mechanical ventilation intakes.


Source of ignition includes: Central or window A/C, Electrical outlet, Electric meter, hot tub motor, pool filters, gas grill, and solar equipment.

Seperation Distances Between Containers, Important Buildings and Line of Adjoining Property That Can Be Built Upon			
Galons of Water Capacity per Container	Mounded or Underground Containers	Aboveground Containers	Between Containers
<125	10	0	0
125-250	10	10	0
251-500	10	10	3
501-2,000	10	25	3
2,001-30,000	50	50	5
30,001-70,000	50	75	
70,001-90,000	50	100	
90,001-120,000	50	125	1/4 of sum of diameters of adjacent containers
120,001-200,000	50	200	
200,001-1,000,000	50	300	
>1,000,000	50	400	

[TANK INSTALLATION GUIDELINES]

DOT Cylinder placement.

Certification date on the protective collar

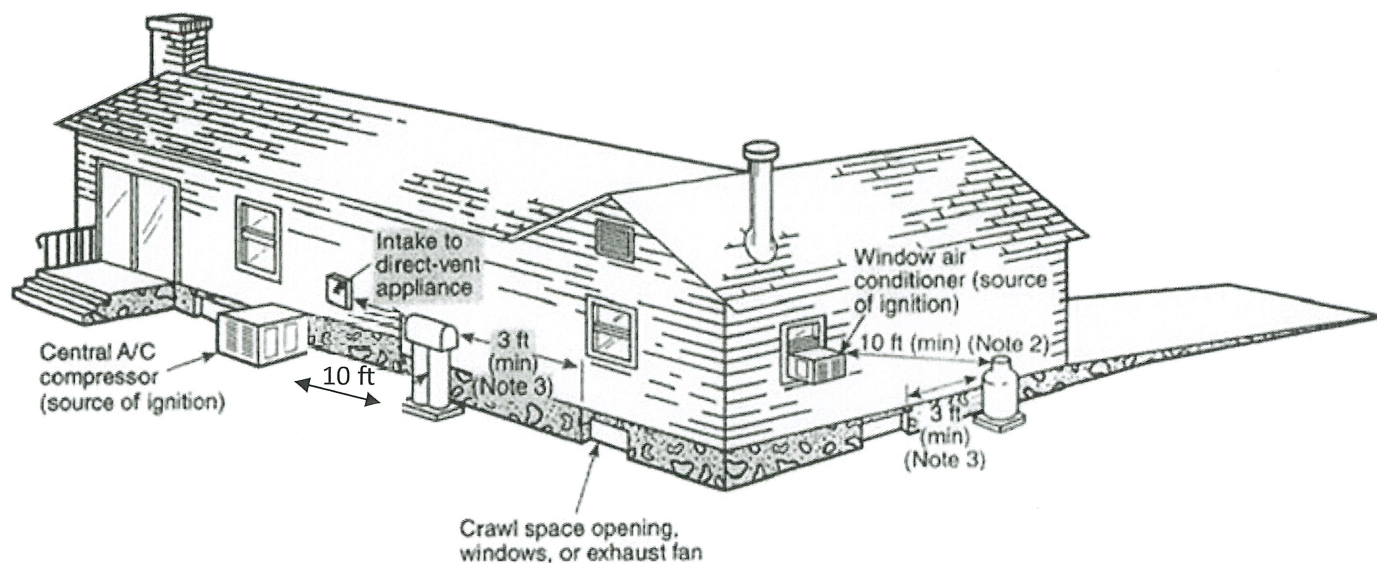

Aboveground ASME containers.

Must have legible Data plate:

